

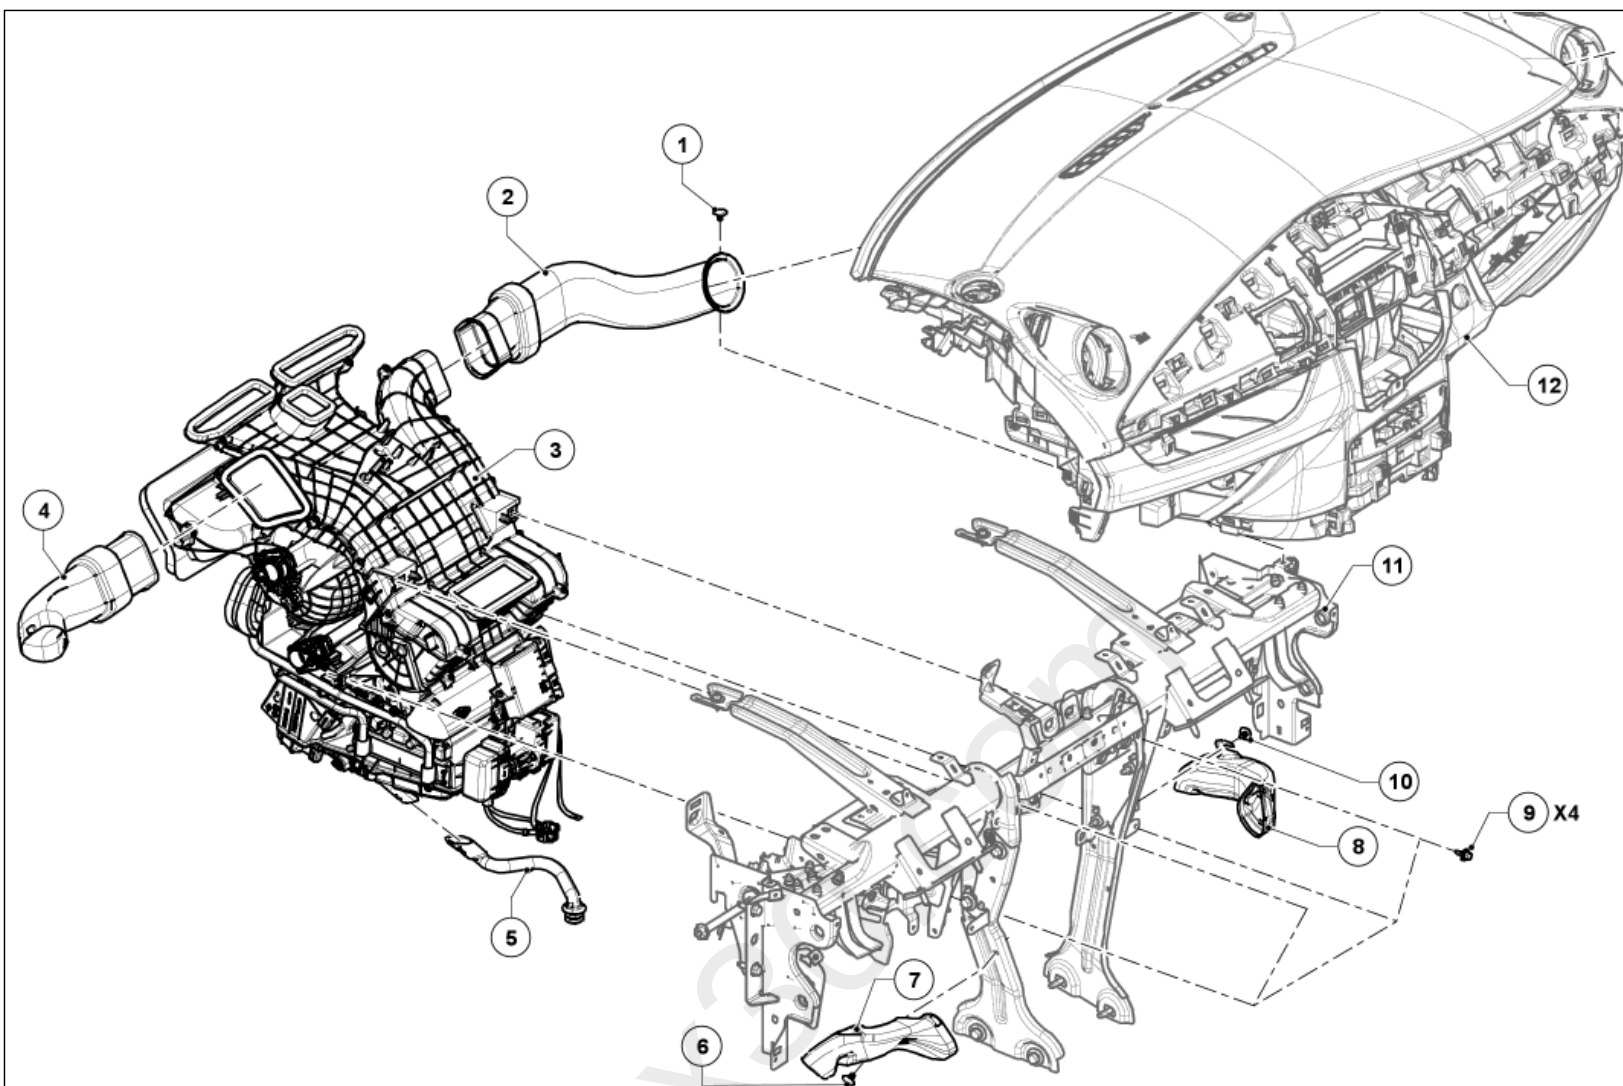


Illustration key: [Description](#) .

For fastenings with no specified tightening torque values, refer to the Table of Standard Torques [Tightening torques: General information](#) .

Marks	Designations	Informations
3	Distribution unit	(see 61A, Heating, Distribution unit: Removal - Refitting)
5	Condensate drain pipe	
6	Clip	
7	A-pillar air distribution duct	(see 61A, Heating, Front footwell air distribution duct: Removal - Refitting)
8	A-pillar air distribution duct	(see 61A, Heating, Front footwell air distribution duct: Removal - Refitting)
9	Bolt	
10	Clip	
11	Dashboard cross member	
12	Dashboard	Dashboard: Removal - Refitting

Marks	Designations	Informations
1	Clip	
2	Front side air distribution duct	(see 61A, Heating, Front side air distribution duct: Removal - Refitting)



Repair-30x02x08-02x50-1-4-1.xml



XSL version : 3.02 du 22/07/11

mcx30.com